

WEHD1000 TANK SPECIFICATIONS

DIMENSIONS:

WALL: 3 1/2"
 BOTTOM: 5"
 COVER: 6"
 MANHOLE: 24" I.D. PRECAST CONCRETE RISER
 HEIGHT: 72 1/2" O.D.
 OUTSIDE DIAMETER: 86 1/2" O.D.
 BELOW INLET: 54 5/8" O.D.
 LIQUID LEVEL: 46 5/8"
 WEIGHT: TANK 7,000 LBS.
 WEIGHT: COVER 3,000 LBS.

INLET AND OUTLET:

4" CAST-A-SEAL BOOT, GASKET OR EQUAL

INLET AND OUTLET Baffle AND FILTER:

WISCONSIN, SEE DETAIL #10
 (OTHER STATES SEE CHART)

LIQUID CAPACITY: 21.50 GAL/IN

HOLDING TANK:

OUTLET HOLE PLUGGED
 ACTUAL CAPACITY: 1065 GALLONS

LOADING DESIGN: 12' 0" UNSATURATED SOIL / HS-20

TANK CAN BE USED AS:


SEPTIC / HOLDING / PUMP OR SIPHON

COVER: MIX DESIGN #8 (NO FIBER)


TANK: MIX DESIGN #8 (NO FIBER)

CUSTOMIZED TANKS:

FOR CUSTOM TANKS CONTACT WIESER CONCRETE

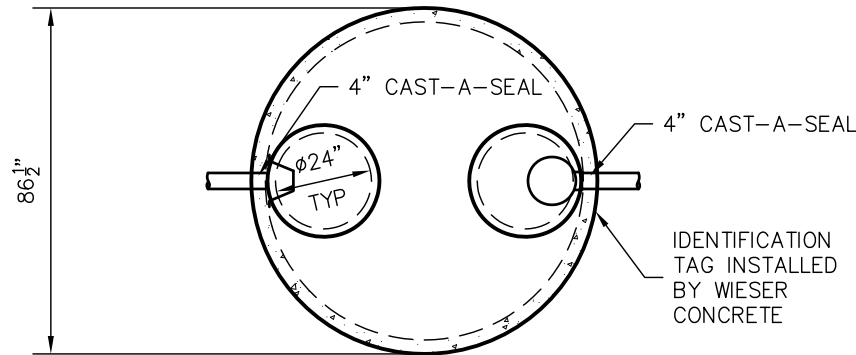

TOP VIEW

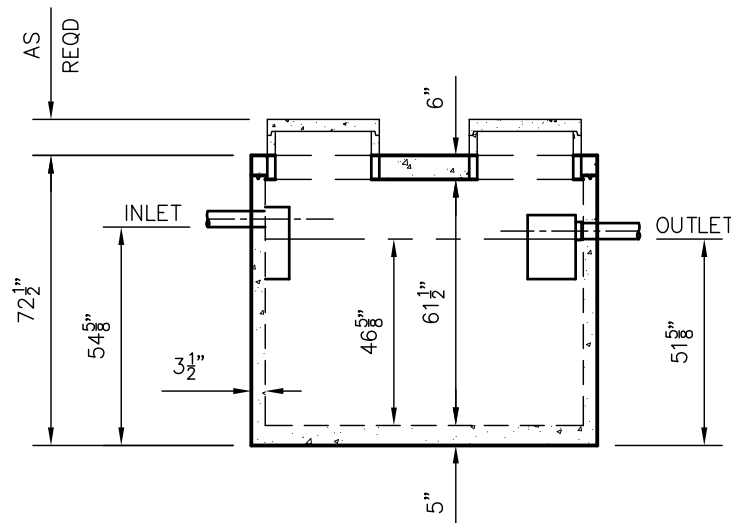

SIDE VIEW

TANKS ARE MANUFACTURED TO MEET OR EXCEED ASTM C-1227 REQUIREMENTS

| | |
|----------------------------------------|-------|
| DRAWINGS SUBMITTED FOR APPROVAL | |
| APPROVED BY: _____ | _____ |
| APPROVAL DATE: _____ | _____ |
| PRODUCTS NEEDED BY: _____ | _____ |

| | | | |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------|-----------|------------|
| DRAWN BY: WCP | SCALE: 1/4" = 1'-0" | PRE-FOUR: | POST-POUR: |
| DATE: 00/00/00 | REV. DATE: | | |
| <p style="font-size: 2em; font-weight: bold; margin: 0;">WIESER CONCRETE</p> <p style="font-size: 0.8em; margin: 0;">W3716 US HWY 10 MAIDEN ROCK, WI 54750</p> <p style="font-size: 1.2em; margin: 0;">800-325-8456</p> | | | |
| WEHD1000 | SEPTIC MANUAL | | |
| | | | SHEET NO. |
| | | | 1 OF 1 |