



# WLP1280/800-FDL TRIPLE TANK SPECIFICATIONS

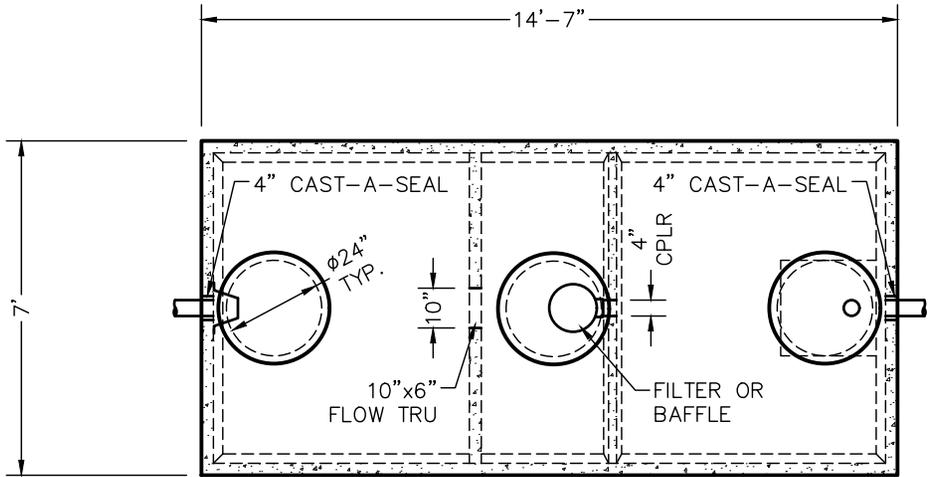

TOP VIEW

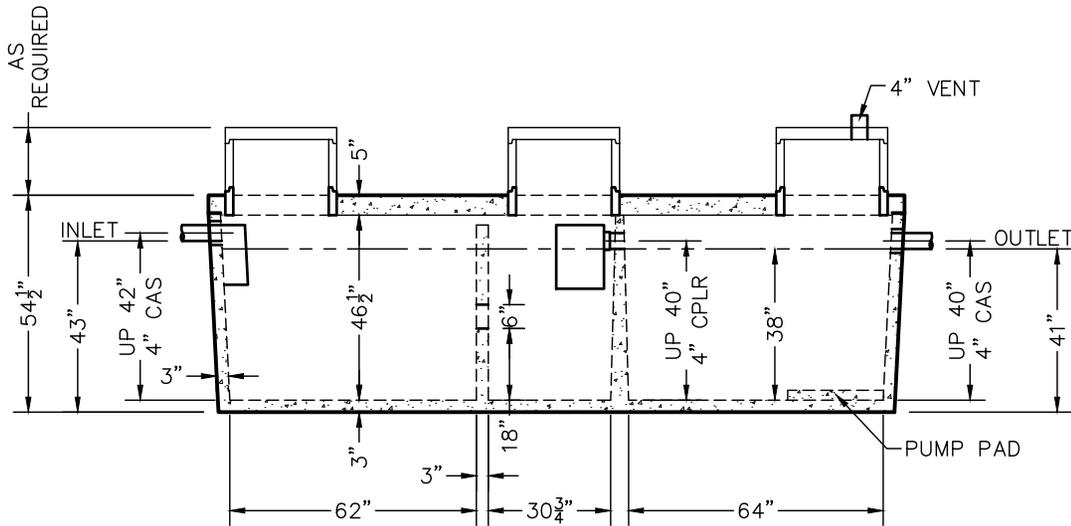

SIDE VIEW

**DIMENSIONS:**  
 WALL: 3"  
 BOTTOM: 3"  
 COVER: 5"  
 MANHOLE: 24" I.D. PRECAST CONCRETE RISER  
 HEIGHT: 54 1/2" O.D.  
 LENGTH: 14'-7" O.D.  
 WIDTH: 7'-0" O.D.  
 BELOW INLET: 43" O.D.  
 LIQUID LEVEL: 38"  
 WEIGHT: BOTTOM 12,420 LBS.  
 COVER 6,380 LBS.

**INLET AND OUTLET:**  
 4" CAST-A-SEAL BOOT OR EQUAL GASKET

**INLET AND OUTLET BAFFLE AND FILTER:**  
 WISCONSIN, SEE DETAIL #10  
 (OTHER STATES SEE CHART)

**LIQUID CAPACITY:** 21.52 GAL/IN (SEPTIC)  
 10.68 GAL/IN (SEPTIC)  
 20.60 GAL/IN (SEPTIC)

**LOADING DESIGN:** 8'-0" UNSATURATED SOIL

**TANK CAN BE USED AS:**  
 SEPTIC/SEPTIC, SEPTIC/PUMP  
 OR SEPTIC/SIPHON

**COVER:** MIX DESIGN #8 (NO FIBER)  
**TANK:** MIX DESIGN #9 (SMALL FIBER)

**CUSTOMIZED TANKS:**  
 FOR CUSTOM TANKS CONTACT WESER CONCRETE

REVIEWED BY \_\_\_\_\_  
 REVIEW DATE \_\_\_\_\_

**DRAWINGS SUBMITTED FOR APPROVAL**

APPROVED BY: \_\_\_\_\_  
 APPROVAL DATE: \_\_\_\_\_  
 PRODUCTS NEEDED BY: \_\_\_\_\_

TANKS ARE MANUFACTURED TO MEET OR EXCEED ASTM C-1227 REQUIREMENTS

PRE-POUR:	REV.	DATE:
POST-POUR:	SCALE: 1/4" = 1'-0"	REV. DATE:
	DRAWN BY: WCP	REV. DATE:
	DATE: 00/00/00	REV. DATE:
	FILE: wlp1280-800 triple fdl	
<b>WESER CONCRETE</b>		
W3716 US HWY 10, MAIDEN ROCK, WI 54750		
800-325-8456		
WLP1280-800 TRIPLE FDL		
SEPTIC MANUAL		
SHEET NO.		
1 OF 1		