



GENERAL NOTES

COMPARTMENT #1 CAPACITY =  
 50% OF TOTAL SEPTIC MIN.  
 75% OF TOTAL SEPTIC MAX.  
 COMPARTMENT #2 CAPACITY =  
 25% OF TOTAL SEPTIC MIN.  
 50% OF TOTAL SEPTIC MAX.

DETAIL 17  
SUPER SCREEN

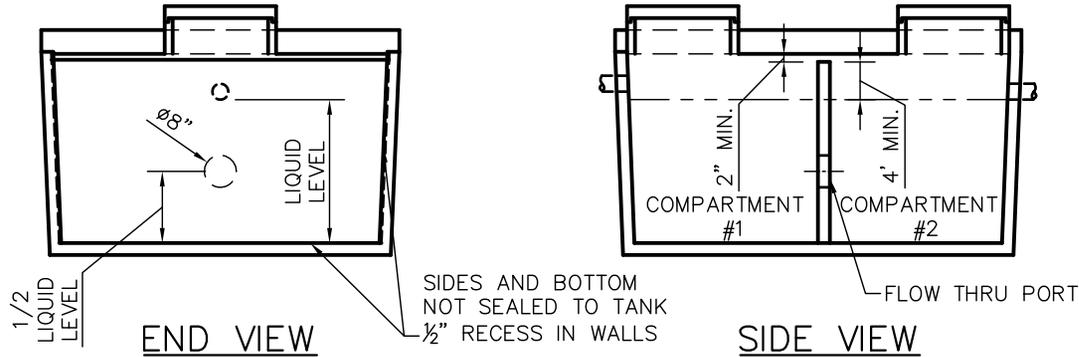

SEPTIC TANK

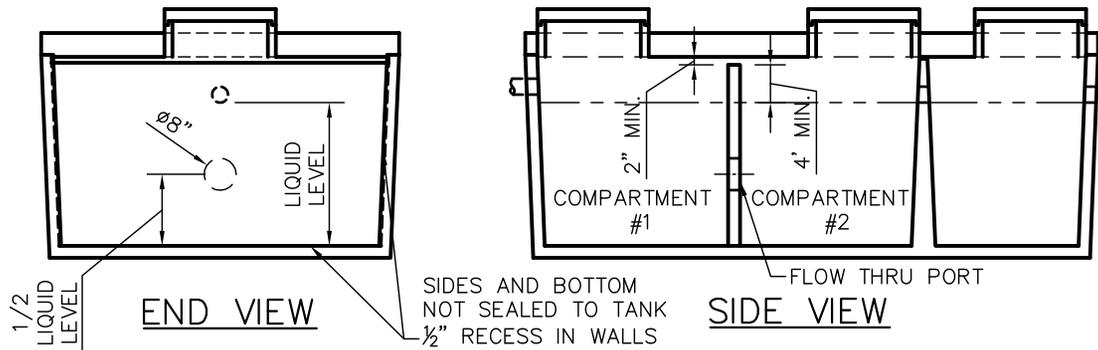

SEPTIC /PUMP OR SEPTIC / SIPHON

PRE-POUR:

SCALE: NTS  
 REV.

DATE: JANUARY 2010

POST-POUR:

DATE:

FILE: SHEET 17

**WIESER CONCRETE**  
 W3716 US HWY 10 MAIDEN ROCK, WI 54750  
 800-325-8456

SUPER SCREEN  
 SEPTIC MANUAL  
 REV. JAN. 2010

SHEET NO.  
 1 OF 1